

Daylight Visualizer

OÚ Mečeříž

Project name: Zasedací místnost - po
Simulation type: Daylight Factor
Daylight Visualizer version: 3.1.32

Select Country

Czech Republic


▼

Select Report Options

- ☒ EN17037
- ☐ Active House
- ☐ Percentiles

EN17037 For Czech Republic the target daylight factors (D_T) are 2.0% (300 lux), 3.4% (500 lux) and 5.0% (750 lux). The minimum daylight factor target (D_{TM}) is 0.7% (100 lux). The standard is available for purchase from the National Standardization Body in your country.

ZASEDACÍ MÍSTNOST

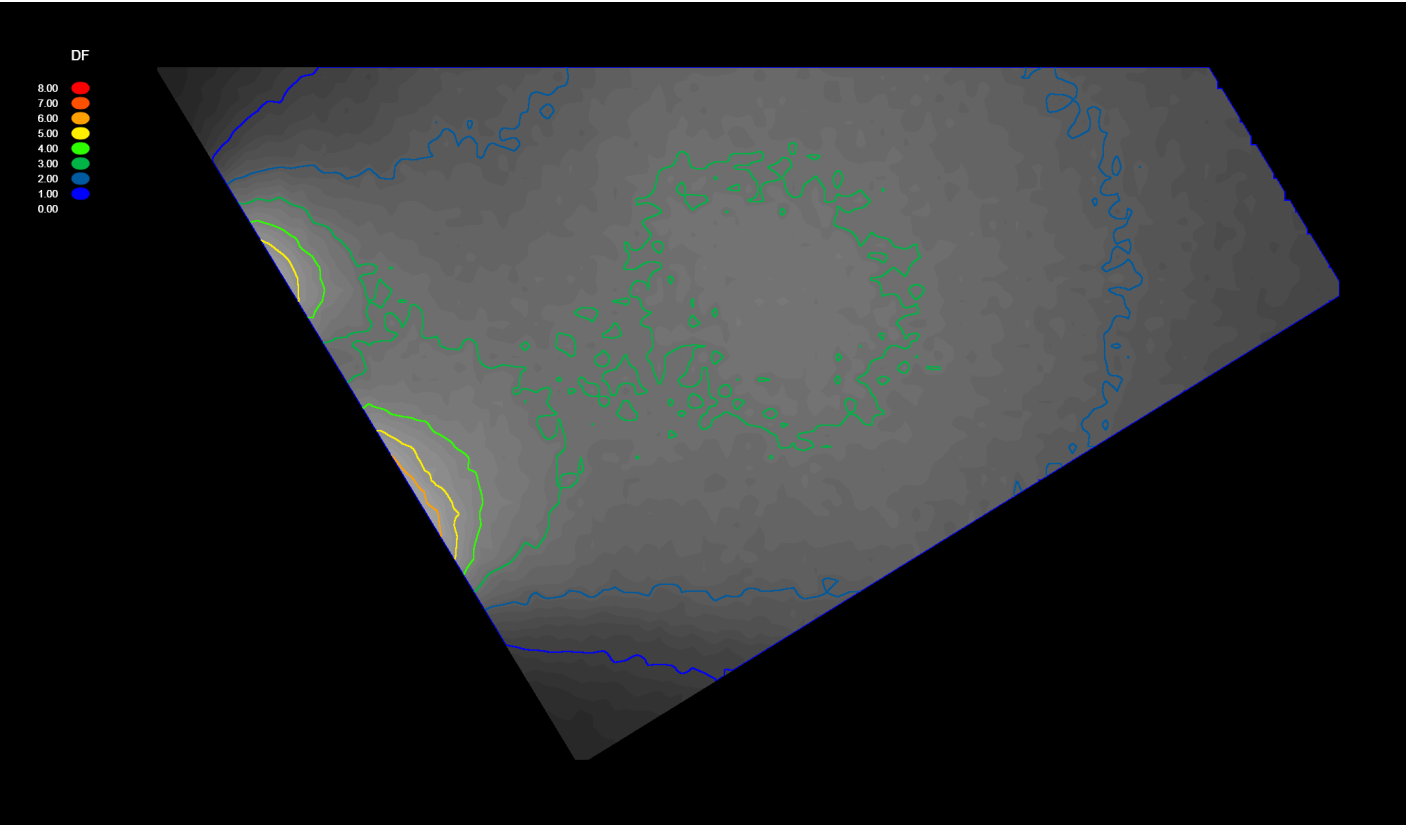

Average	D	2.45%
Median	D	2.54%
Minimum	D	0.28%
Maximum	D	6.57%
Uniformity 1	D_{min}/D_{avg}	0.1146
Uniformity 2	D_{min}/D_{max}	0.0428

EN17037

$F_{\text{plane}, \%} \geq 0.7\%$	D_{TM}	98%	Pass ($\geq 95\%$)
$F_{\text{plane}, \%} \geq 2.0\%$	D_{T}	74%	Pass ($\geq 50\%$)

Notes