

# Daylight Visualizer

## OÚ Mečeříž

Project name: Zasedací místnost - před  
Simulation type: Daylight Factor  
Daylight Visualizer version: 3.1.32

### Select Country

Czech Republic


▼

### Select Report Options

- ☒ EN17037
- ☐ Active House
- ☐ Percentiles

**EN17037** For Czech Republic the target daylight factors ( $D_T$ ) are 2.0% (300 lux), 3.4% (500 lux) and 5.0% (750 lux). The minimum daylight factor target ( $D_{TM}$ ) is 0.7% (100 lux). The standard is available for purchase from the National Standardization Body in your country.

## ZASEDACÍ MÍSTNOST

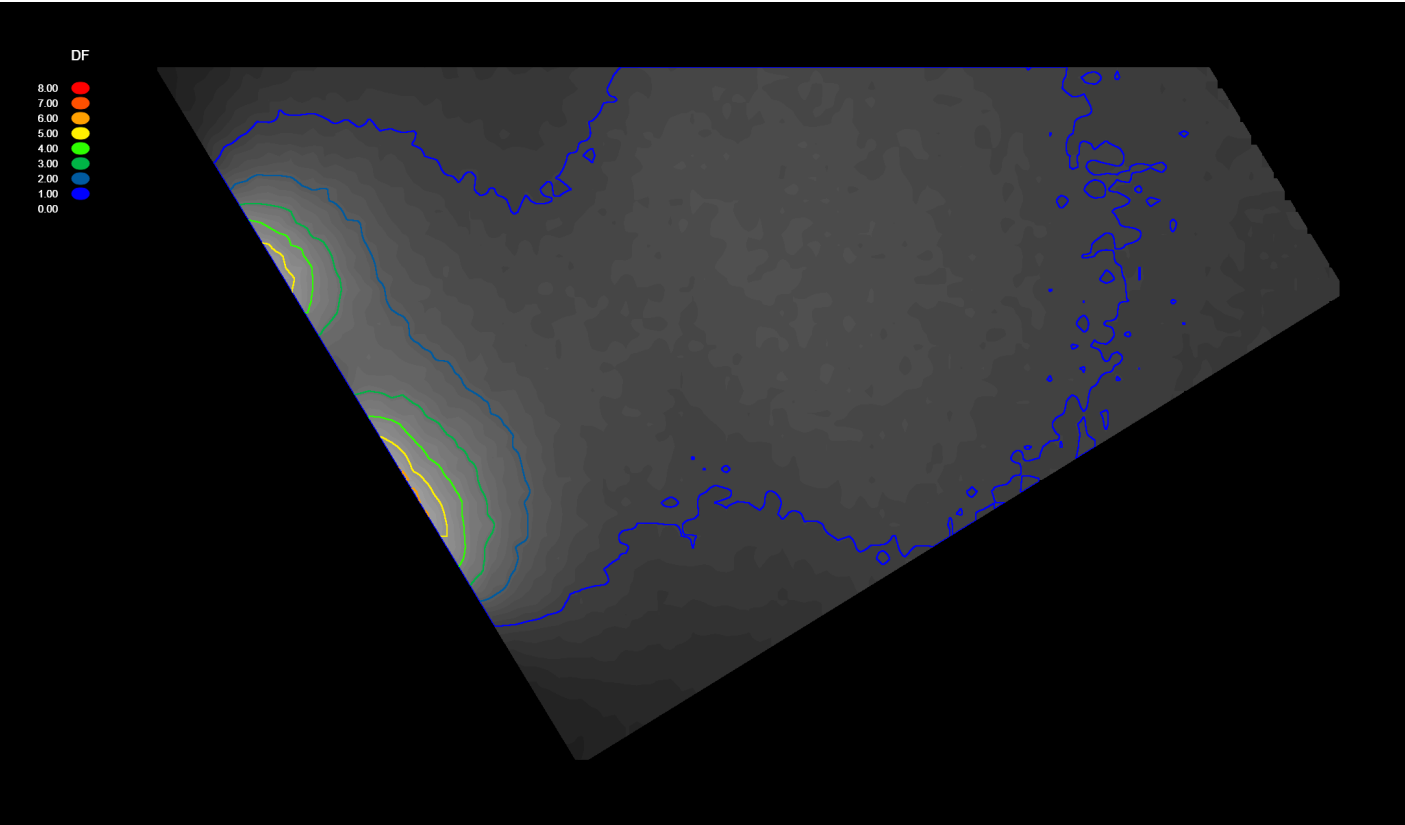

|              |                   |        |
|--------------|-------------------|--------|
| Average      | D                 | 1.30%  |
| Median       | D                 | 1.18%  |
| Minimum      | D                 | 0.24%  |
| Maximum      | D                 | 6.16%  |
| Uniformity 1 | $D_{min}/D_{avg}$ | 0.1838 |
| Uniformity 2 | $D_{min}/D_{max}$ | 0.0386 |

**EN17037**

|                                   |                 |     |             |
|-----------------------------------|-----------------|-----|-------------|
| $F_{\text{plane}, \%} \geq 0.7\%$ | $D_{\text{TM}}$ | 94% | Fail (<95%) |
| $F_{\text{plane}, \%} \geq 2.0\%$ | $D_{\text{T}}$  | 9%  | Fail (<50%) |

**Notes**