





ŘEZ A - A

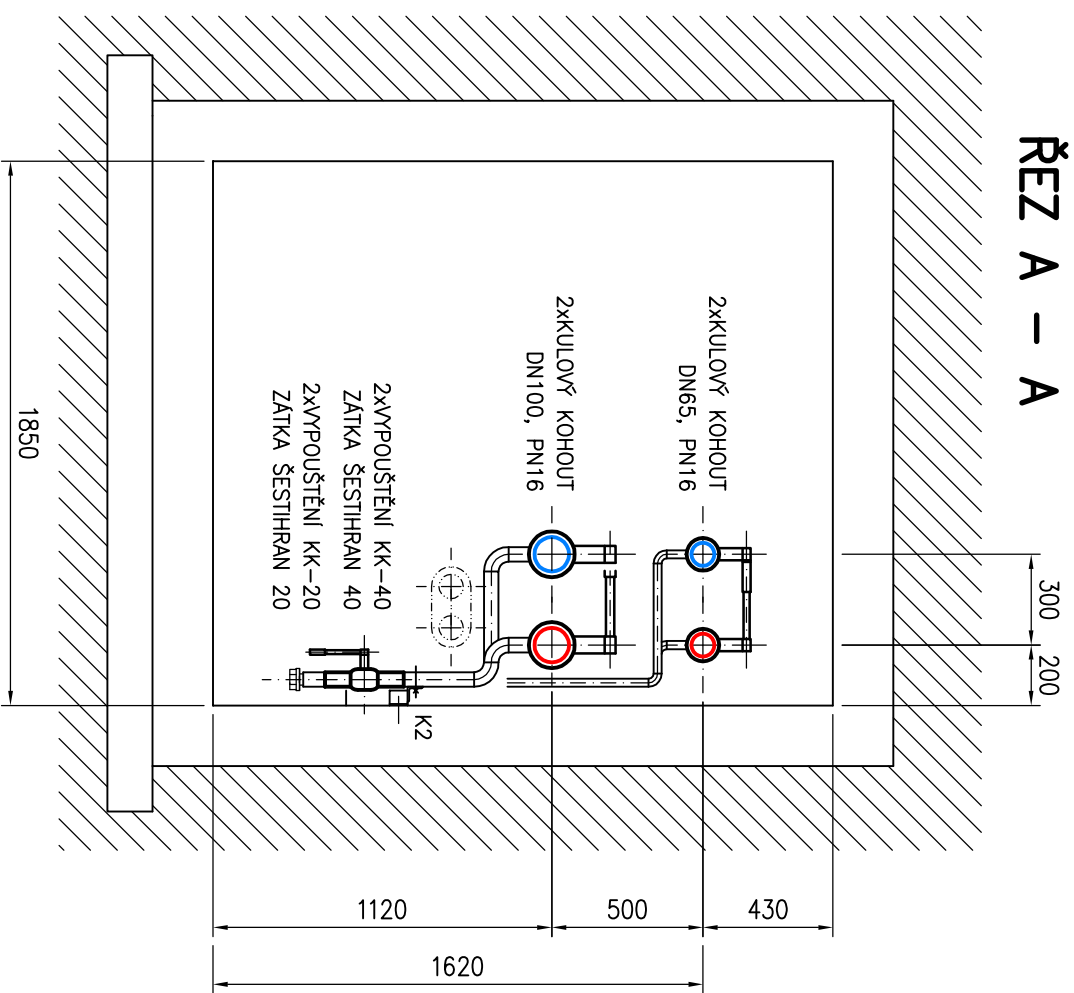



ŘEZ B - B

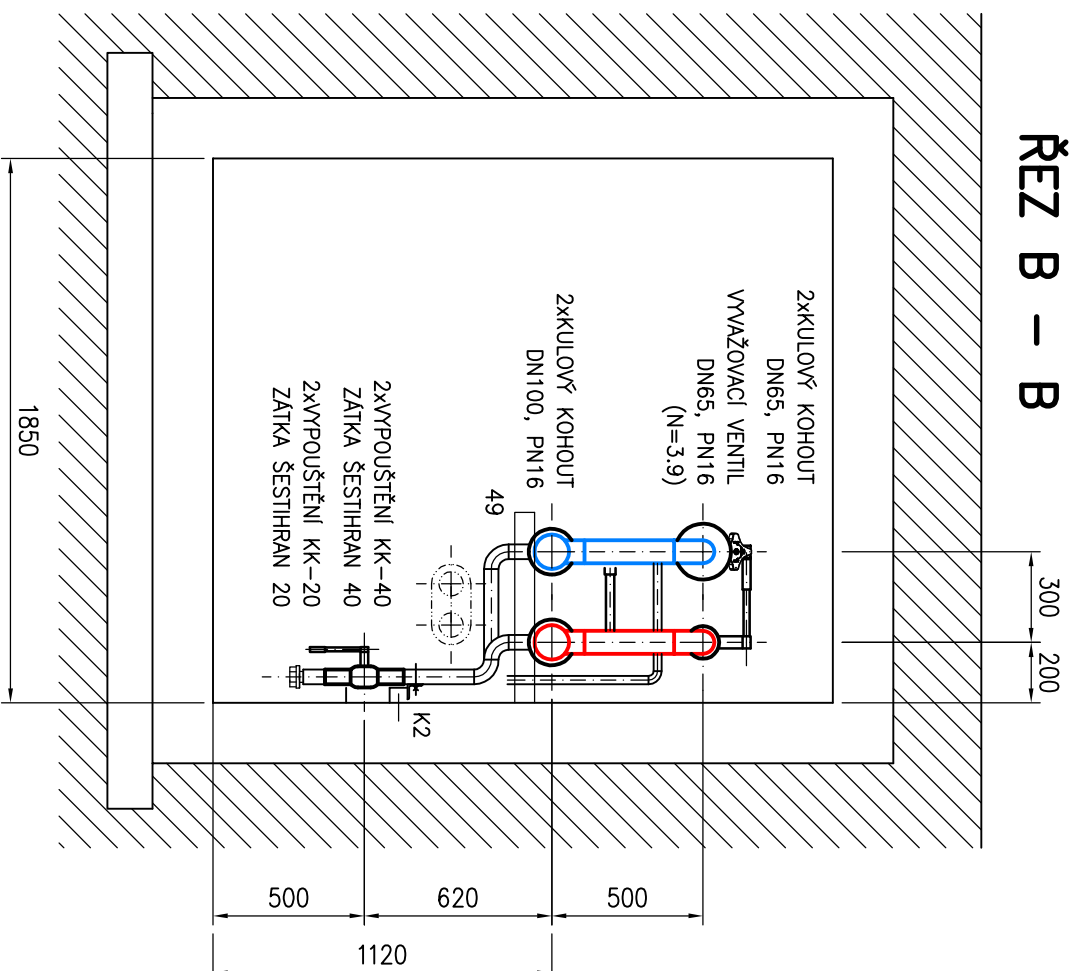

ŘEZ C - C

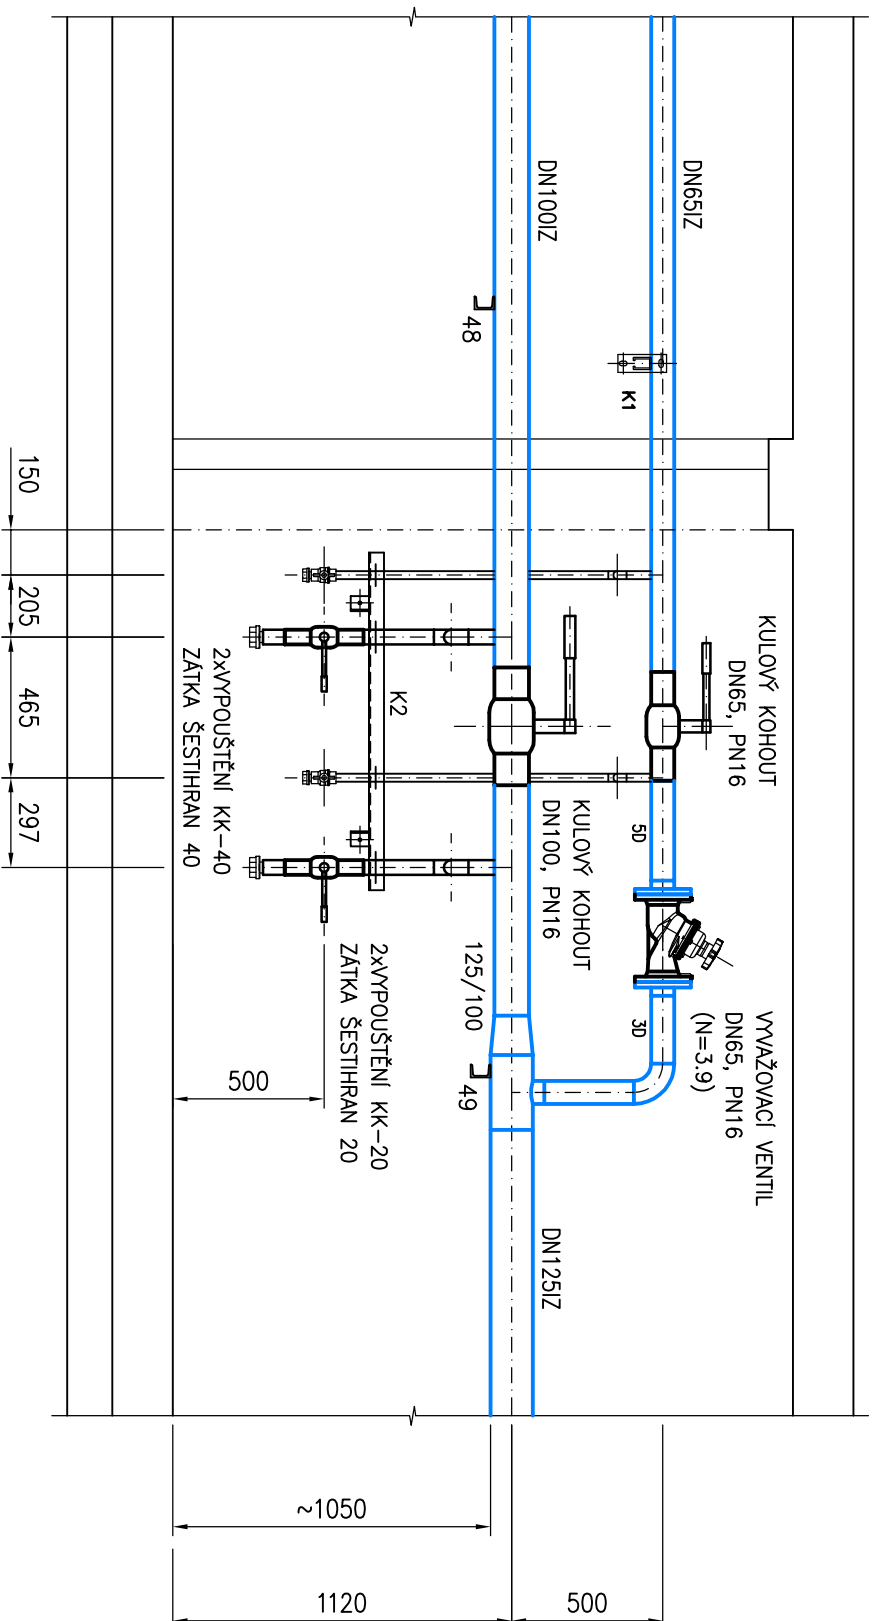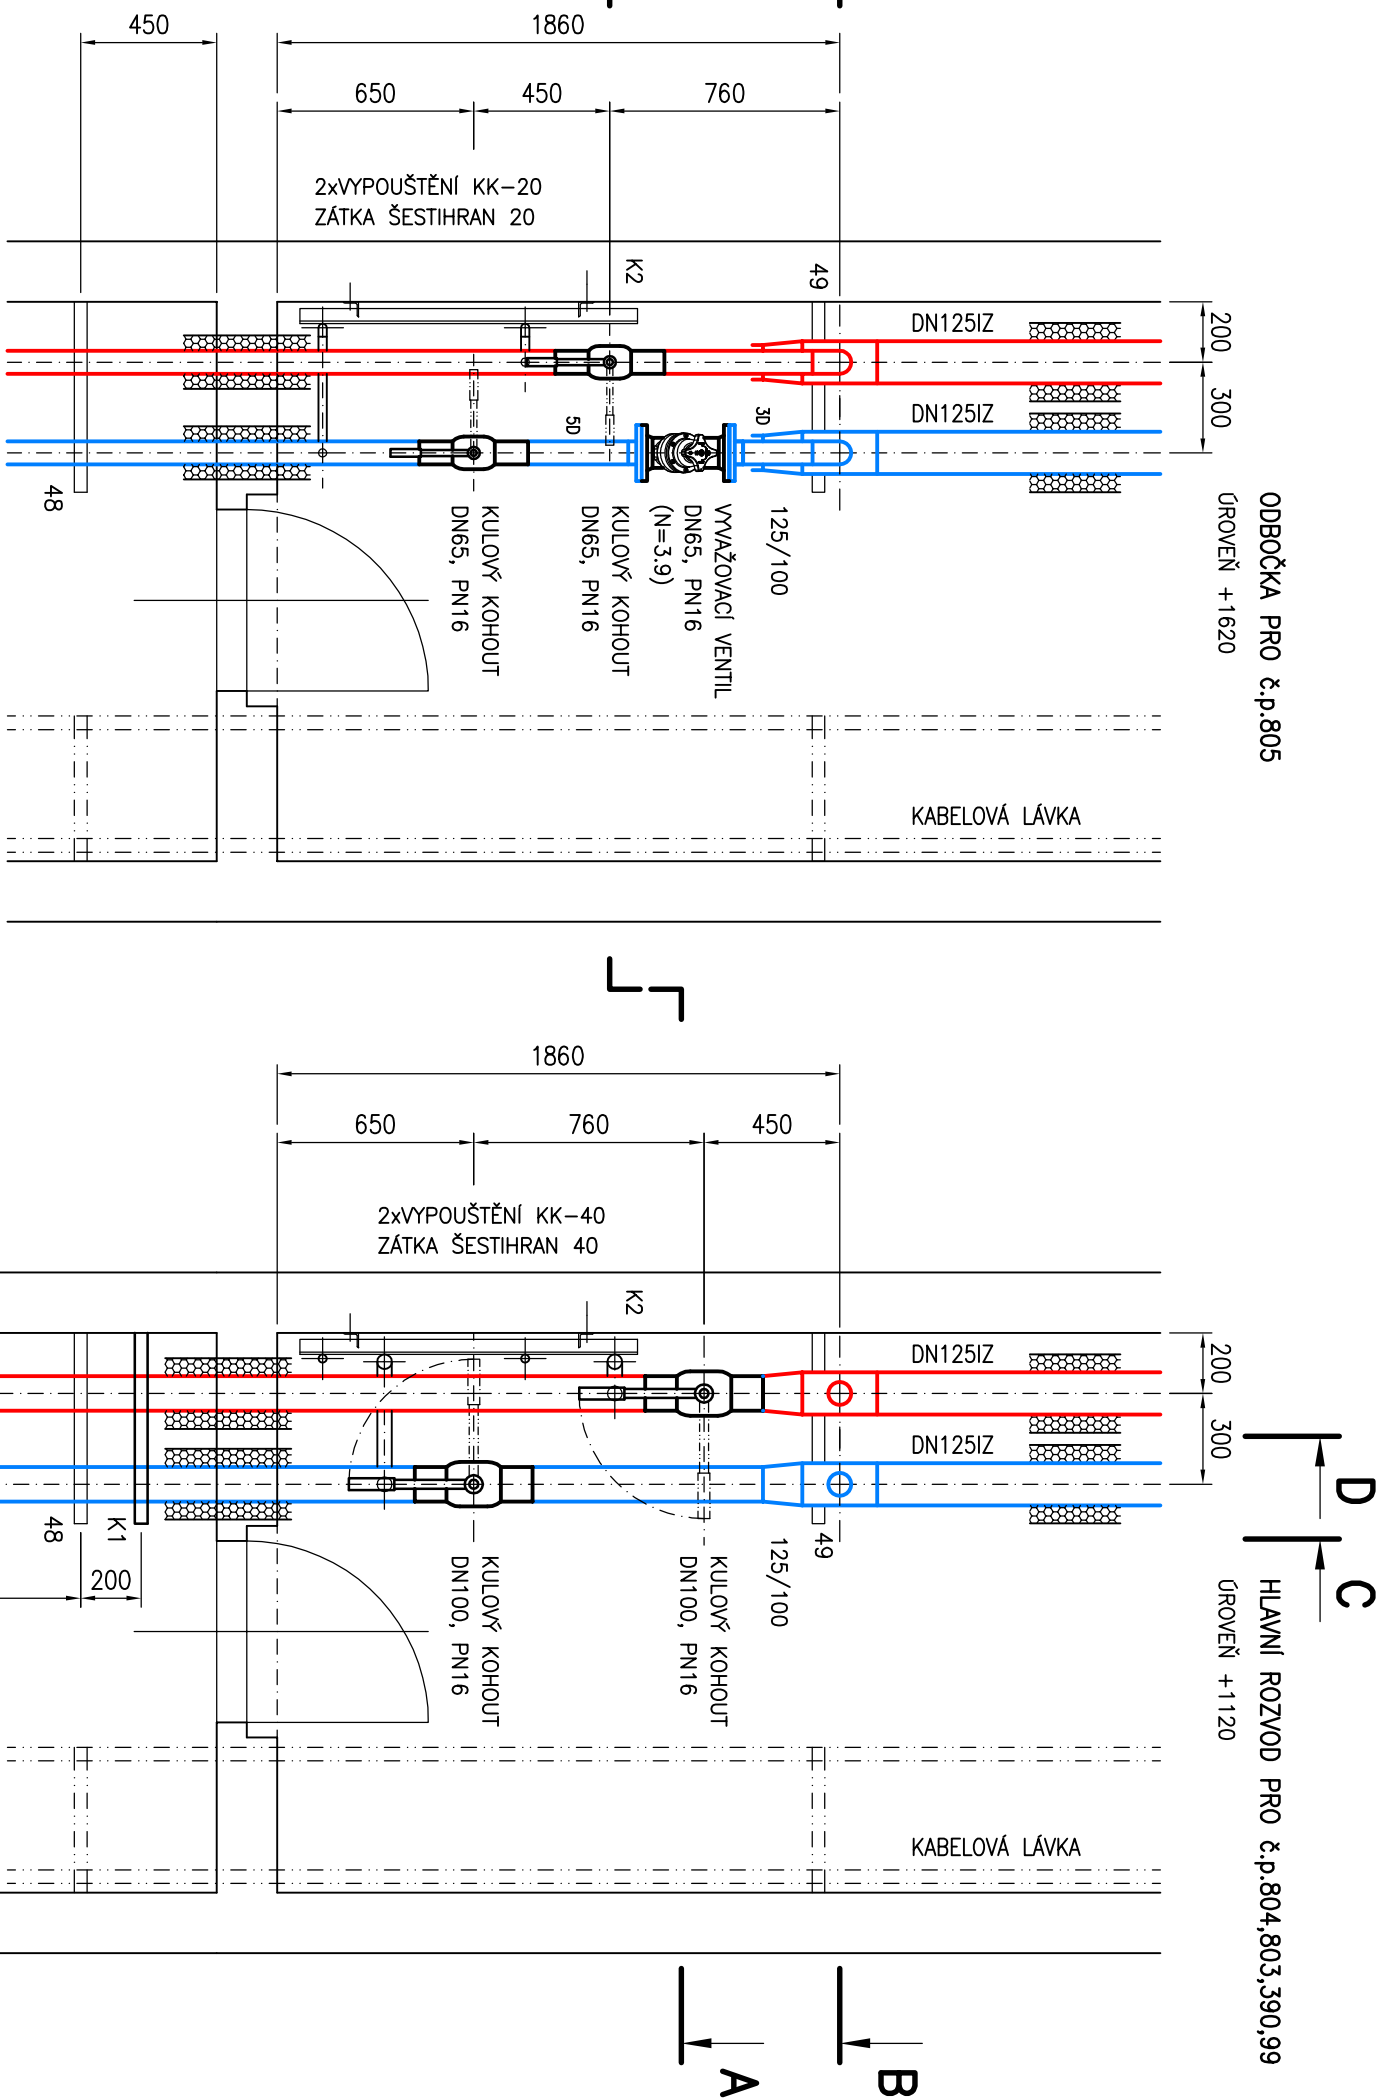

ŘEZ D – D

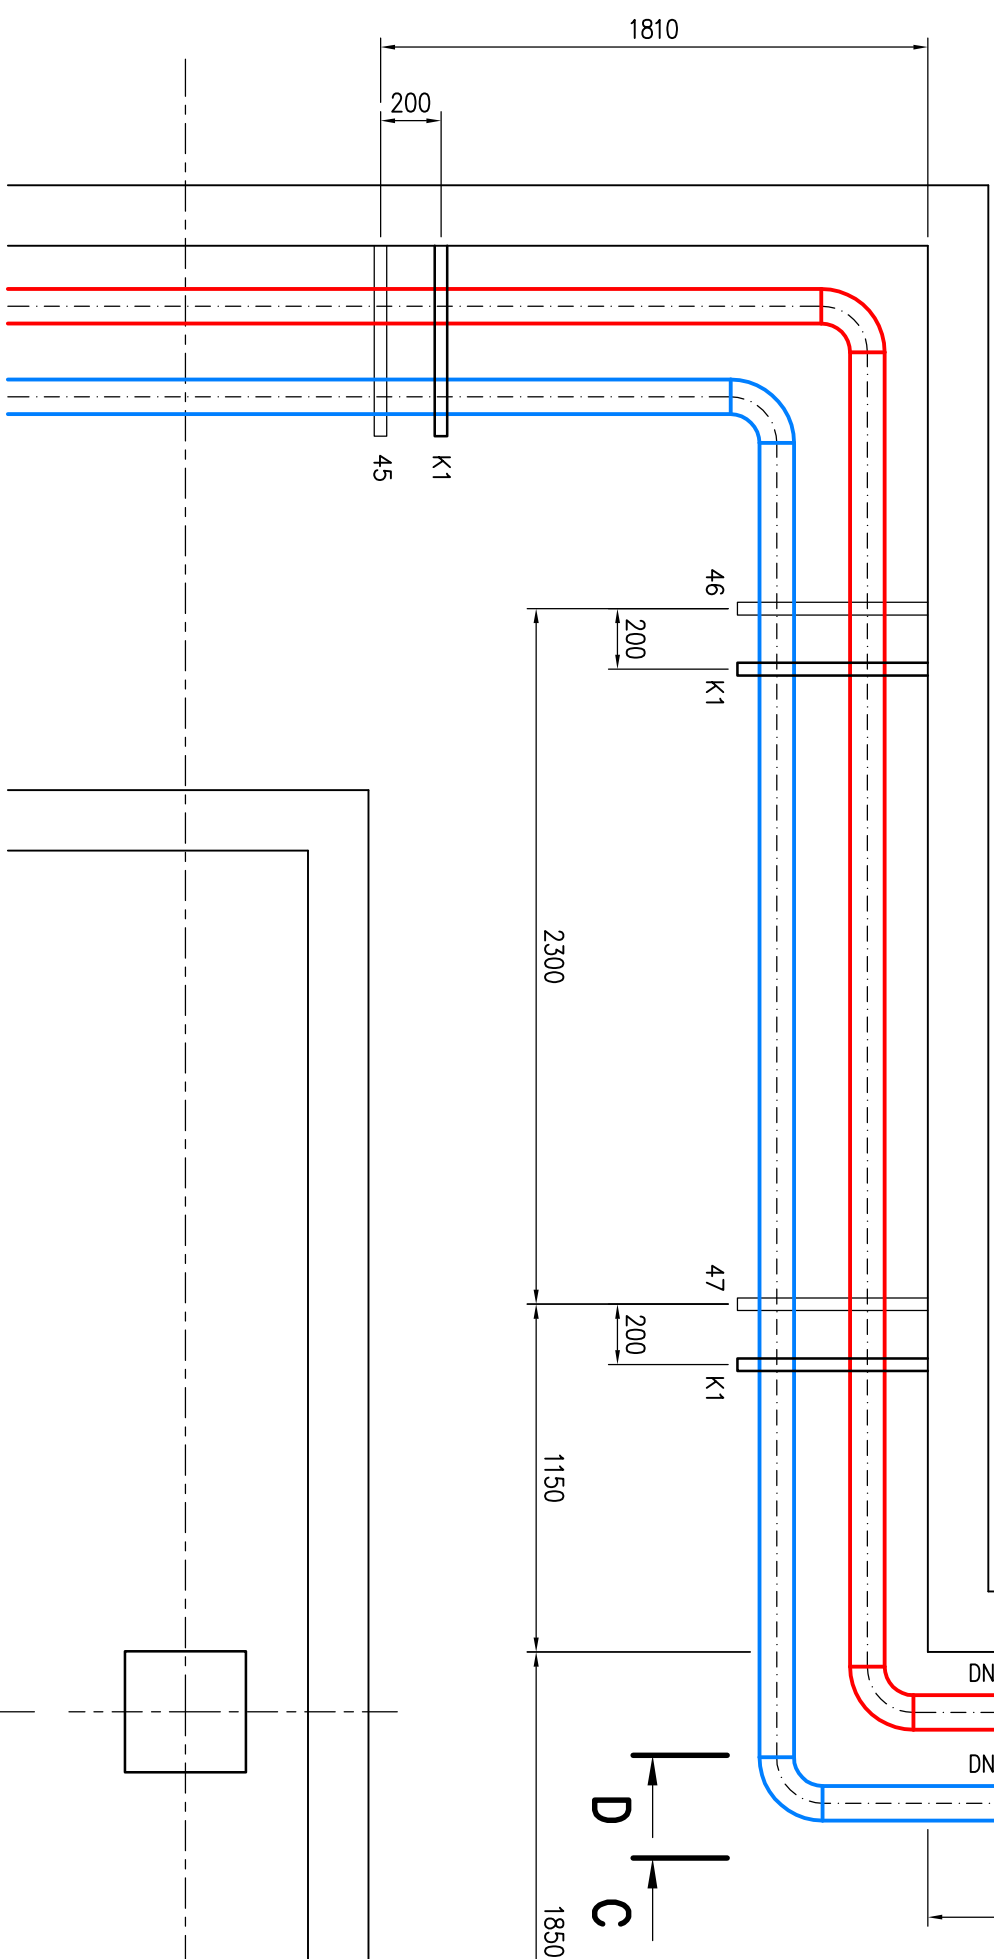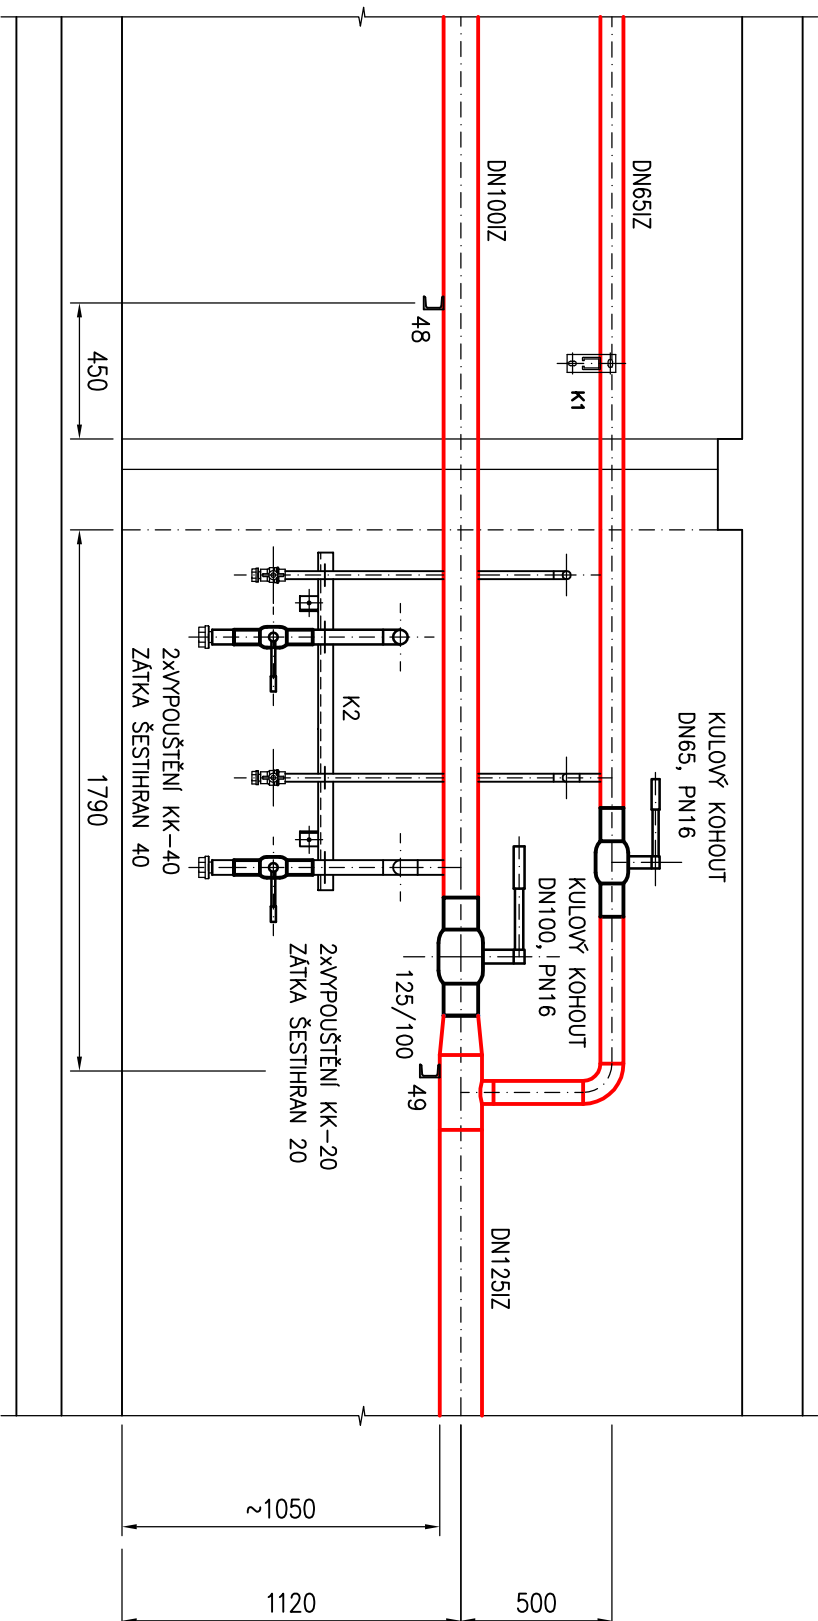

	TOPNÁ VODA (OT-P) – PRŮMOD	
		
	TOPNÁ VODA (OT-Z) – ZPĚTČKA	
NOVÉ OCELOVÉ TRUBKY BEZESÝE		
PRO ROZVODY OT		
DN15 –	ø21.3x2.65 MM	IZOLACE PE 20 MM
DN20 –	ø26.9x2.65 MM	IZOLACE MV 25 MM
DN25 –	ø33.7x3.25 MM	IZOLACE MV 25 MM
DN32 –	ø42.4x3.25 MM	IZOLACE MV 30 MM
DN40 –	ø48.3x3.25 MM	IZOLACE MV 40 MM
DN50 –	ø60.3x3.65 MM	IZOLACE MV 50 MM
DN65 –	ø76.1x2.90 MM	IZOLACE MV 50 MM
DN80 –	ø88.9x3.20 MM	IZOLACE MV 60 MM
DN100 –	ø114.3x3.6 MM	IZOLACE MV 60 MM
DN125 –	ø139.7x4.0 MM	IZOLACE MV 80 MM

ZODPOVĚDNÝ PROJEKTANT		ING. VACLAV REMUTA		Ing. VACLAV REMUTA PRUBEŽNÁ 3372 434 01 MOST IČ: 63756617 DIČ: CZ6612161521
VYPRACOVAL		ING. VACLAV REMUTA		
KRAJ:	ÚSTECKÝ	OBEC:	MOST	
INVESTOR: SEVEROČESKÁ TEPLAŘENSKÁ, a.s., TEPLAŘENSKÁ 2, KOMORÁNY				
AKCE				
REKONSTRUKCE TOPNĚHO KANALU Z VS 803 – ÚT a TV (KOMPLEX KAHAN) D.2.1 TECHNOLOGICKÁ ČÁST, ROZVODY ÚT				
OBSAH VÝKRES		MĚŘÍTKO:		ČÍSLO VÝKRESU:
VSTUP Z T.G.9 DO TK KAHAN		1 : 25		52UD.2.1-A2-06