

Daylight Visualizer

Calculation on zones

Project name: 304 snížený stro_nove
Simulation type: Daylight Factor
Daylight Visualizer version: 3.0.86

Select Country

Czech Republic

▼


Select Report Options

- ☒ EN17037
- ☐ Active House

EN 17037 For Czech Republic the target daylight factor (D_T) is 2.0% and the minimum daylight factor target (D_{TM}) is 0.7%. The standard is available for purchase from the National Standardization Body in your country.

** The illuminance (lux) values stated in brackets are derived from the median external diffuse illuminance recorded in weather data files for the selected location.*

Zone 0

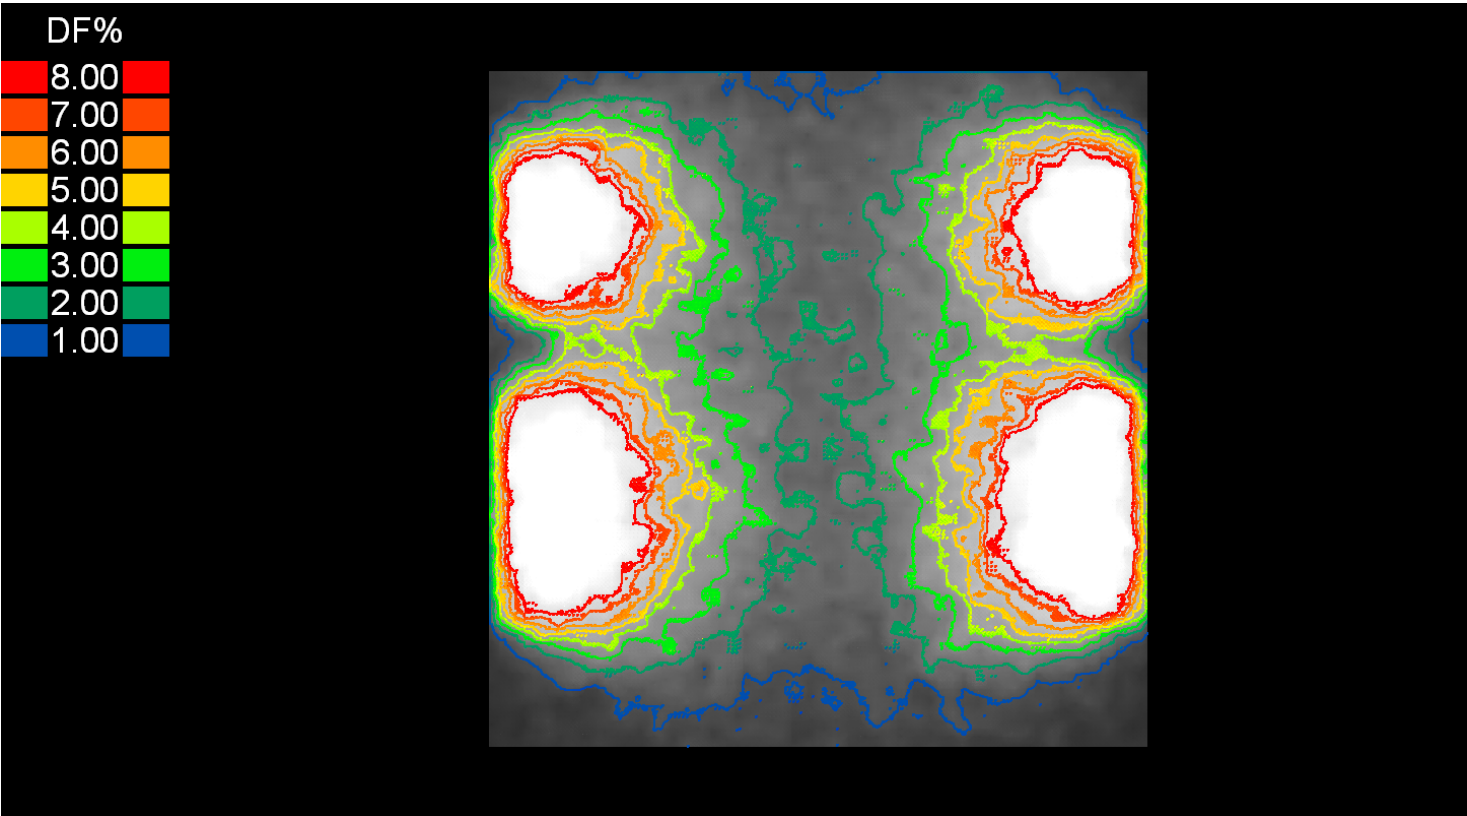

EN17037

$F_{plane, \%} \geq 50\%$ (median)	D_T	2.94 DF[%]	Pass (438 lux)
$F_{plane, \%} \geq 95\%$	D_{TM}	0.73 DF[%]	Pass (109 lux)

Default

Average	$D_{average}$	4.39 DF[%]	
---------	---------------	------------	--

Median	D_{median}	2.94 DF[%]
Minimum	D_{min}	0.32 DF[%]
Maximum	D_{max}	19.13 DF[%]
Uniformity 1	$D_{\text{min}}/D_{\text{average}}$	0.0727
Uniformity 2	$D_{\text{min}}/D_{\text{max}}$	0.0167

Notes

10x MK08 780x 1398 mm

Rozmístění oken, dle návrhu níže

