

Daylight Visualizer

Calculation on zones

Project name: M.Č. 302
Simulation type: Daylight Factor
Daylight Visualizer version: 3.0.86

Select Country

Czech Republic

▼


Select Report Options

- ☒ EN17037
- ☐ Active House

EN 17037 For Czech Republic the target daylight factor (D_T) is 2.0% and the minimum daylight factor target (D_{TM}) is 0.7%. The standard is available for purchase from the National Standardization Body in your country.

** The illuminance (lux) values stated in brackets are derived from the median external diffuse illuminance recorded in weather data files for the selected location.*

Zone 0

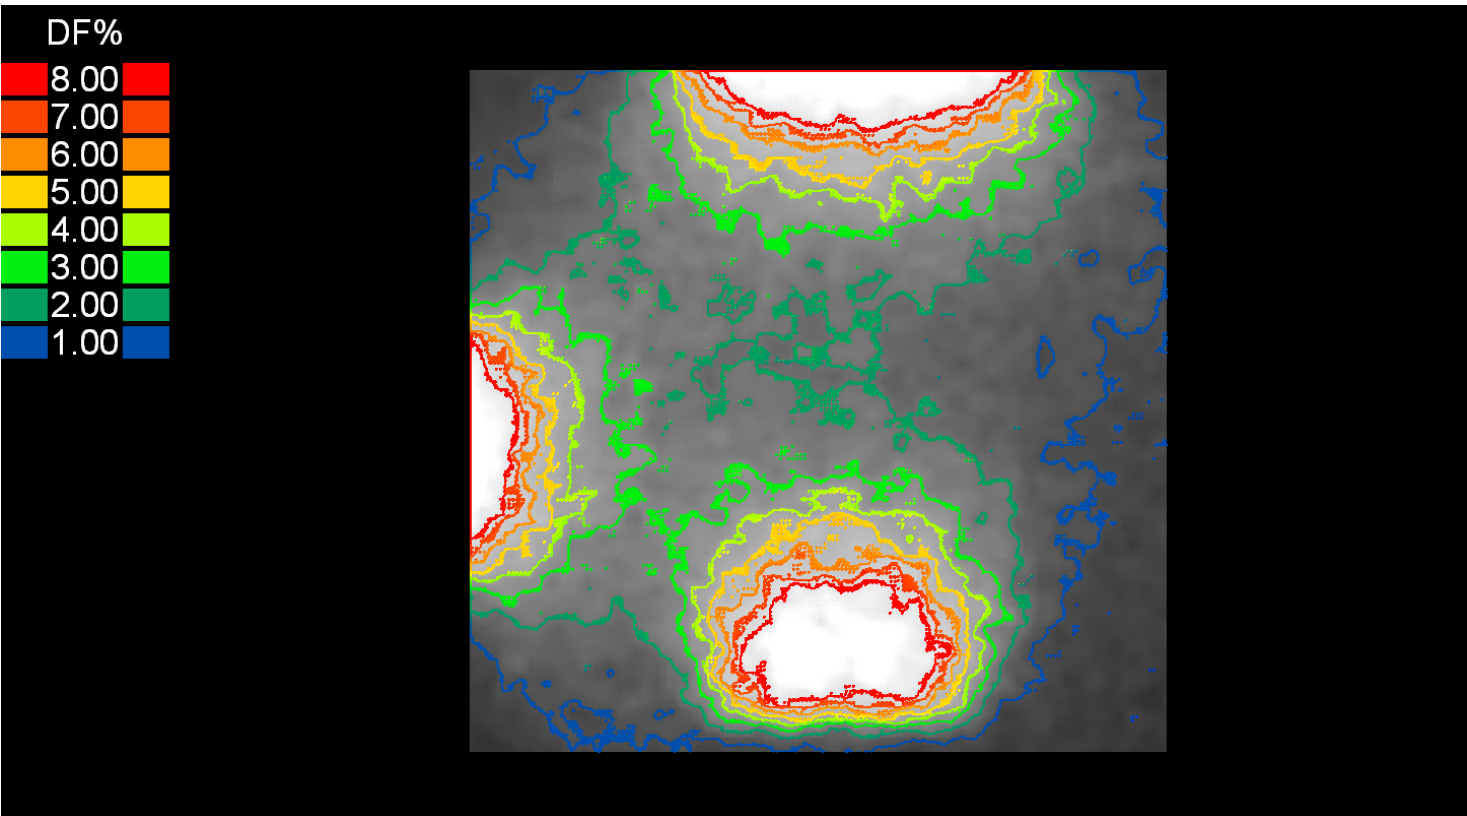

EN17037

$F_{plane, \%} \geq 50\%$ (median)	D_T	2.31 DF[%]	Pass (345 lux)
$F_{plane, \%} \geq 95\%$	D_{TM}	0.71 DF[%]	Pass (106 lux)

Default

Average	$D_{average}$	3.16 DF[%]	
---------	---------------	------------	--

Median	D _{median}	2.31 DF[%]
Minimum	D _{min}	0.36 DF[%]
Maximum	D _{max}	17.00 DF[%]
Uniformity 1	D _{min} /D _{average}	0.1138
Uniformity 2	D _{min} /D _{max}	0.0212

Notes

Fasádní okna + 3x střešní okno MK08 780x1398 mm