


Transmittal, reproduction, dissemination and/or editing of this document as well as utilization of its contents and communication thereof to others without express authorization are prohibited. Offenders will be held liable for payment of damages. All rights created by patent grant or registration of a utility model or design patent are reserved

Filename: PID NÁVRH_REV4_VSD

Rozvodna obj.211 / TIPA 630kVA / zdroj chladu

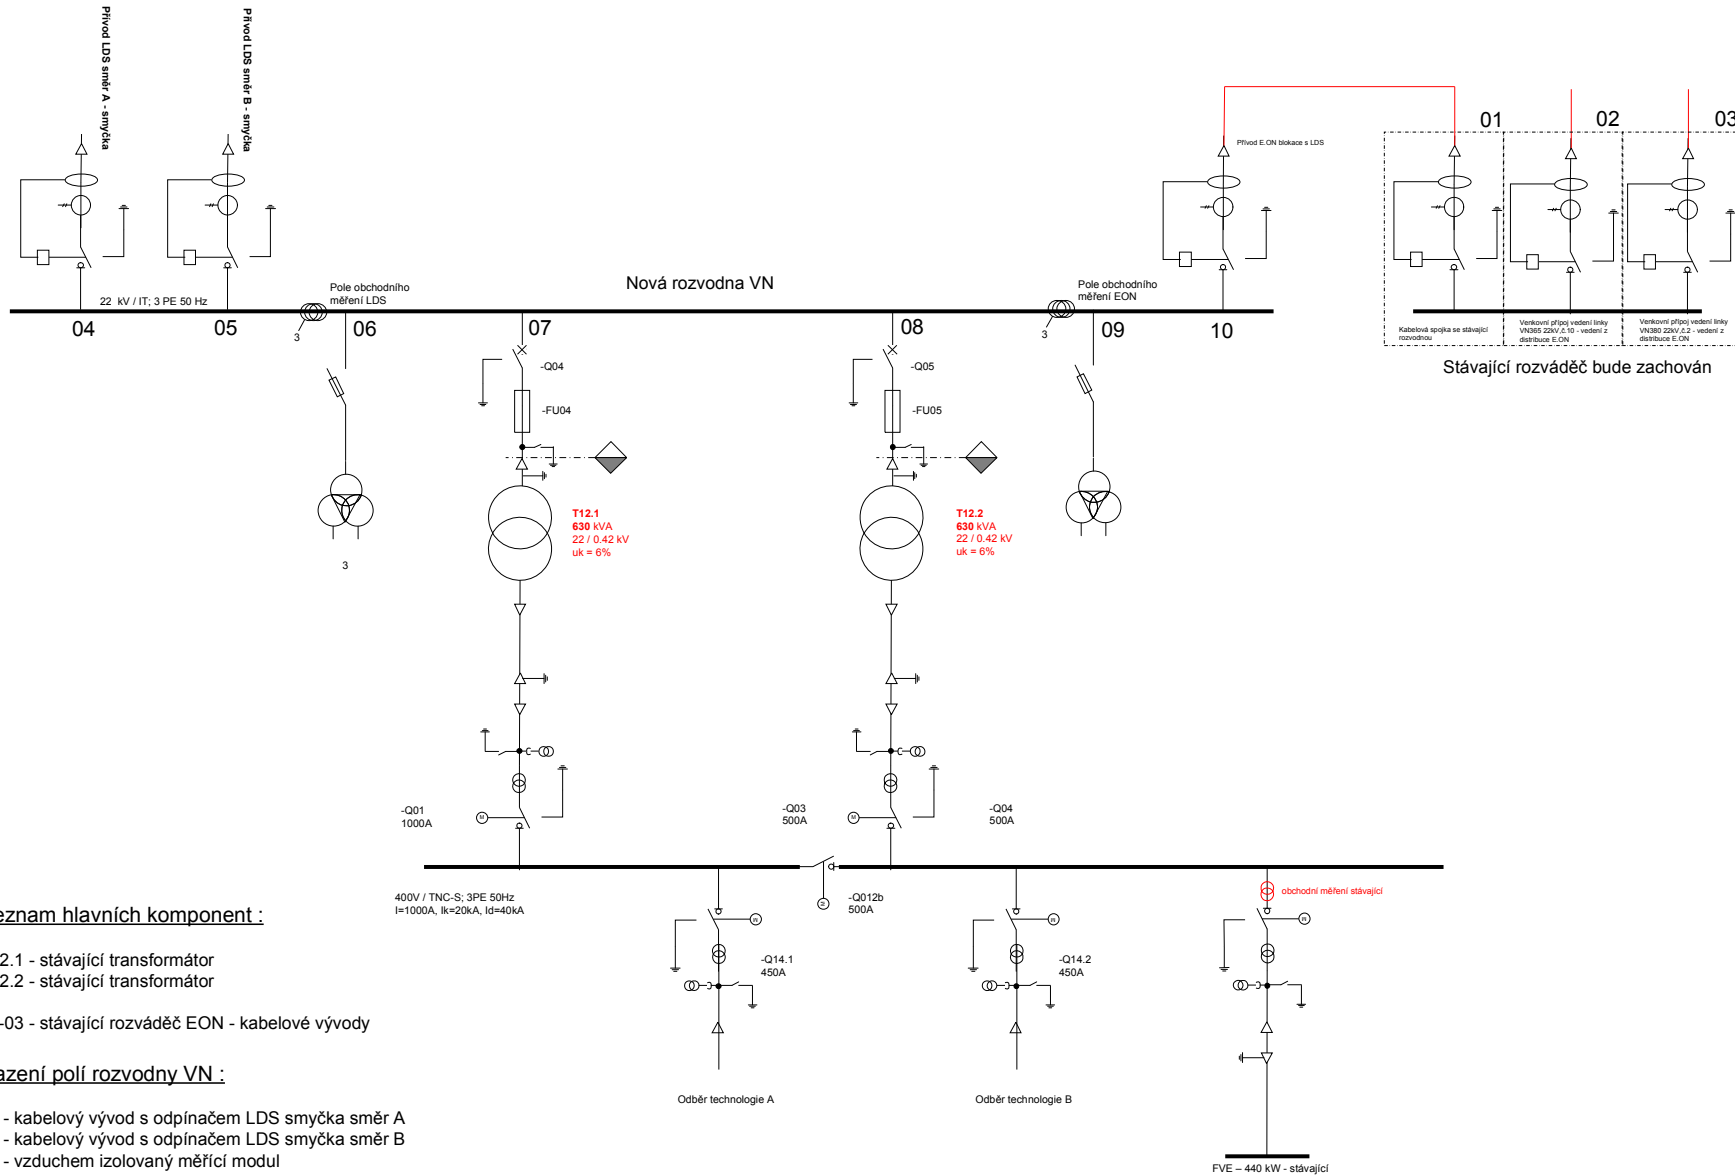

Seznam hlavních komponent :

- T12.1 - stávající transformátor
- T12.2 - stávající transformátor
- 01-03 - stávající rozváděč EON - kabelové vývody

Řazení polí rozvodny VN :

- 04 - kabelový vývod s odpínačem LDS smyčka směr A
- 05 - kabelový vývod s odpínačem LDS smyčka směr B
- 06 - vzduchem izolovaný měřicí modul
- 07 - odpínač a pojistky T12.1
- 08 - odpínač a pojistky T12.2
- 09 - vzduchem izolovaný měřicí modul
- 10 - kabelový vývod s odpínačem EON

Ing. Karel Šilhan	3.4.2017	Date	11.01.2017	Environmental Energy, s.r.o. Žďárského 181, 674 01 Kozichovice IČ : 05427592	ENVIRONMENTAL ENGINEERING	SLD předávací stanice TIPA, část energo	U-V-PS002.2-160201-06	Zdroj KVET 5MWe Kozichovice a rozvody SZT	01
		Created	11.01.2017						
		Check	11.01.2017						
Rev.-Index	Vypracoval	Datum	Name	bas-on	rep-by	rep-for			Sheet 0
1		2		3	4	5	6	7	8